

IN ACCORDANCE WITH NCC VOLUME 2 (SECTION P3.10.1), THIS PRODUCT SATISFIES PERFORMANCE REQUIREMENT P2.1.1 FOR CONSTRUCTION IN A HIGH WIND AREA

### CYCLONE ASSEMBLY COMPONENTS

Comprising of self drilling screw & one piece cyclone washer

#### TYPE 17 WITH BRA WASHER CYCLONE ASSEMBLY


FOR METAL BATTENS & TIMBER BATTENS

14g -10x50/65mm


(HEAD MARKING B8, B8V)

All dimensions in mm (nominal)

Screws are Class 4 in accordance with AS3566

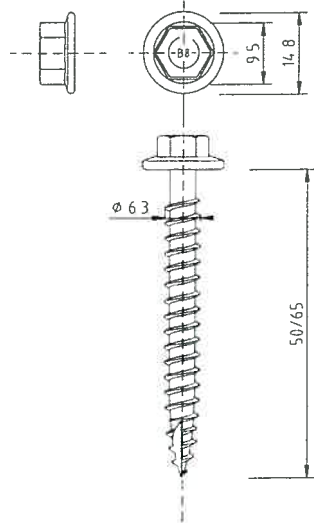


#### BREMICK BRA - CYCLONE WASHER / SEAL ONE PIECE ALUMINIUM / EPDM CYCLONE WASHER

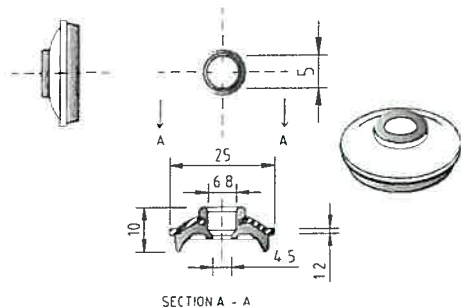

#### FASTENING:

BSL CUSTOM ORB®  
0.42mm BMT G550 min.




#### FASTENING TO:

METAL BATTENS  
0.75mm BMT min.  
G550 min.  
TIMBER BATTENS  
JD3 min.

#### FASTENING:

BSL TRIMDEK®  
0.42mm BMT G550 min.




#### FASTENING TO:

METAL BATTENS  
0.75mm BMT min.  
G550 min.

#### CORRUGATED ROOFING PROFILE - BSL CUSTOM ORB®

#### FASTENER SPACINGS

Crest Fastener Locations : Alternate Ribs (152mm Centres)  
Spans Tested : 900mm End, 1150mm Intermediate, 900mm End

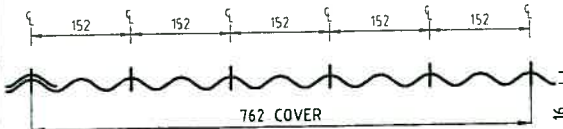


Supports	Crest Fixing	Side Lap Fixing
Metal Battens 0.75mm BMT min. G550 min.	Bremick Type 17 14-10x50 BRA	Bremick Vortex™ Stitch M6 5-13x20 (900 mm Centres min.)
Timber JD3 min.		

#### SQUARE RIB ROOFING PROFILES - BSL TRIMDEK®

#### FASTENER SPACINGS

Crest Fastener Locations : Each Rib (190mm Centres)  
Spans Tested : 1200mm End, 1500mm Intermediate, 1200mm End

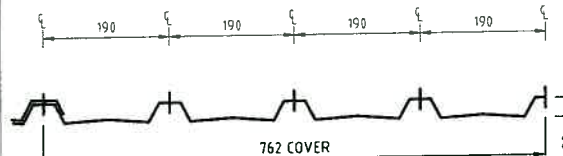

Supports	Crest Fixing	Side Lap Fixing
Metal Battens 0.75mm BMT min. G550 min.	Bremick Type 17 14-10x65 BRA	Bremick Vortex™ Stitch M6 5-13x20 (900 mm Centres min.)

Product Name

TYPE 17 BRA Cyclone Assembly

Product Description : Roofing Fasteners

T17 14-10x50/65 - BRA Cyclone Assembly  
With Lysaght Profiles

Manufacturer's Name: BREMICK Pty Ltd  
F1, 62 Maddox Street  
Alexandria NSW 2015  
Ph: 02 8332 1501  
Email: sales@bremick.com.au

#### Design Criteria

Fastener & support spacing to be controlled such that the maximum design loading per fastener or maximum design pressures do not exceed:

Table 1 : Strength Limit State Design Loads per Fastener

Roofing Profile	Test Load (kN)	C.O.V. (K <sub>t</sub> )	Design Load (kN)
Custom Orb®	0.88	1.30	0.68
Trimdek®	1.05	1.30	0.81

Table 2 : Strength Limit State Design Pressures

Roofing Profile	Test Pressure (kPa)	C.O.V. (K <sub>t</sub> )	Design Capacity (kPa)
Custom Orb®	5.36	1.30	4.12
Trimdek®	4.04	1.30	3.11

Fixing of side laps with stitching screws is generally considered good practice during installation to maintain a weather-tight seal.

#### Limitations

This sheet confirms the structural adequacy of the roof sheeting assembly (sheeting, screw and washer) when correctly installed and does not extend to the capacity of the batten/purlin. Refer to the sheeting & batten manufacturers data for maximum support spacings. Axial withdrawal capacity for each fastener exceeds the 3.1kN requirements of AS 3566.1:2002 - Self-drilling screws for building and construction industries - General requirements and mechanical properties.

Strength limit state fastener loads have been derived from the test pressures using simplified static analysis with the uniform pressure (load) distribution.

The fastener is only applicable for use with BlueScope Lysaght cladding products with the conditions described in this data sheet.

#### Accepted for Inclusion

DTCM ref: M/400/01

Chairman's Signature:

Chairman's Name: Paul Nowland

Date of Approval: 28/07/2021 Expiry Date: 28/07/2026

Testing was undertaken using fasteners with the "Revolution B8" coating system, indicated by the B8 & B8V head marking. Bremick fasteners has undertaken independent testing for "Revolution B8" coated fasteners in accordance to AS 3566:2002 and has met and exceeded the requirements for Class 4 coating finish.

To achieve the required energy efficiency requirements, the use of an insulation spacer may be required. Refer to the roof sheeting manufacturers' recommendations of the particular roof profile insulation thickness combination. A longer screw of the same type may be required which will not impact on the capacity of the screw. As long as the major thread diameter clears the underside of the purlin to ensure maximum thread engagement.

Test Certificate Numbers

EngTest Report No. C090201, Low High Low Testing for Bremick Fasteners, 22 April 2009

Trevor John & Associates Report No: TR04 23 March 2009, TR06 20 March 2009, & TR10 25 March 2009.

#### \*Checking Engineers Certification

Name: LEO NOICOS  
Registration Number: NER 70762  
Date: 01.07.2021  
Signature: [Signature]

\*registered as a structural engineer in Australia

#### \*Certifying Engineers Certification

Name: RACHAEL ZEUNER  
NT Registration Number: 30A710ES  
Date: 5/7/2021  
Signature: [Signature]

\*\*registered as a structural engineer in the Northern Territory