
NORTHERN TERRITORY DEEMED TO COMPLY MANUAL - National Construction Code (NCC) Volume 2

This product has been determined to satisfy NCC Performance Requirement H1P1 for structural resistance of materials and forms of construction in high wind areas

GOOD NEIGHBOUR CYCLONIC FENCING **No Shielding Option**



| Post Type | | | | | | | | |
|---------------------|---|-----------|-----------|---------------------------------------|-----------|-------------|--|--|
| Terrain Category | Fence Height (Both posts into footings) | | | Fence Height (SHS only into footings) | | | | |
| | 1200 | 1500 | 1800 | 1200 | 1500 | 1800 | | |
| 1.0 | Standard Post | 50×50×2.0 | 75×75×2.5 | 65×65×2.5 | 65×65×3.0 | 100×100×2.5 | | |
| 2.0 | Standard Post | 50×50×1.6 | 65×65×2.5 | 50×50×3.0 | 65×65×2.5 | 75×75×3.0 | | |
| 2.5 | Standard Post | 50x50x1.6 | 65×65×2.0 | 50×50×3.0 | 65×65×2.5 | 75×75×3.0 | | |
| 3.0 | Standard Post | 50×50×1.6 | 65×65×2.0 | 50×50×2.5 | 65×65×2.5 | 75×75×3.0 | | |


| Fix | king | De | tails |
|-----|------|----|-------|
| | | | |

CGI

Superdek, Smartspan

Standard Post

- Fence tracks are to be fixed to the post with one 12x20mm self drilling screw on each side.
- Sheets are to be fixed to the tracks using 10x25mm self drilling screws as per the above screw fixing locations.
- Fasten sheets midspan at the overlap using a 3mm rivet.
- Posts are to be fixed to each other using 12x20mm self drilling screws at a maximum spacing of 500mm.

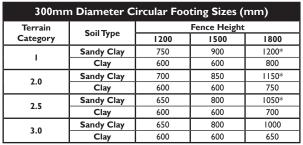


*Alternatively, footing diameter may be increased to 450mm and the footing depth reduced to 900mm

All SHS require

post caps

- I. All SHS posts to be minimum C350.
- 2. All screws must have minimum Class 4 corrosion resistance.
- 3. Panel widths shall be reduced at free ends. A free end is defined as an end which does not form part of a corner and does not butt up against a solid structure. It shall comprise 4 single sheets with posts between each sheet (ie. 5 posts total).

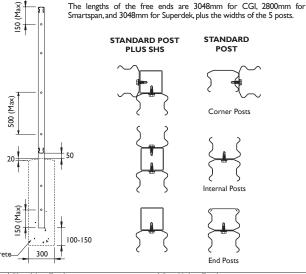

Notes covering basis of DTC (Relevant test reports etc)

Good Neighbour® Fence Panels have been tested at University of Adelaide by Engtest (Ref. C041001) dated 20th October 2004 and conform to the strength requirements of AS 4040.3-1992 and AS 1562.1-1992.

Superdek: I 590mm CGI:1630mm

Smartspan: I 470mm

(Add 50/65/75/100mm for SHS Post if required)

Design Criteria determined in accordance with AS/NZS1170.2:2021 Wind Actions.

Footing Specifications:

- Footings shall be founded in natural soil only with minimum 250kPa ultimate foundation bearing capacity. Fence installer shall seek additional engineering advice for soil conditions outside of those specified.
- Concrete to be minimum N20 grade with top of footings shaped to direct water away from posts.

Checking Engineer

Name: Glenn Turner

Registration Number: NER 382373 I

Date: 14/03/2025

Certifying Engineer

Name: Matthew Mammone NT Registration Number: 243890ES

Date: 14/03/2025

Aust be a registered structural engineer in the Northern Territo

Product Name

Good Neighbour® Fencing No Shielding Option

Product Description

Post and track manufactured from 0.8mm BMT G550 steel, minimum Z275 coating. Infill panels manufactured from 0.35mm BMT G550 steel, minimum AM100 coating (pre-painted), and minimum AM125 (unpainted).

Manufacturer's Details

Stratco (Australia) Pty Ltd

780 Stuart Highway, Berrimah NT 0828. ABN 30 007 528 850

Design Criteria

The following criteria was used in the development of the tables:

- Region C with an annual probability of exceedence of 1:200
- $Vr = Mc \times 61 \text{ m/s}$ (limit state), with Mc = 1.05
- Importance Level I
- Ms = 1.0, Mt = 1.0, Md = 1.0 for cladding and track design Md = 0.9 for post and footing design

Mz,cat(1.0) = 0.97

Mz,cat(2.0) = 0.91

Mz,cat(2.5) = 0.87

Mz,cat(3.0) = 0.83

Refer AS/NZS 1170.2:2021 Structural design actions Part 2: Wind Actions for definition of local pressure zones.

Pressure Coefficients:

Cp (max) = +1.2 for general fence area

= +2.4 for a distance of 2H from free ends

Limitations

Accepted for inclusion in Deemed to Comply Manual

DTCM drawing number:

M/850/01

Chairperson Signature:

Chairperson Name: Dr Elisha Harris

Date of Approval: 9/04/2025 Expiry Date: 9/4/2030