


PLAN

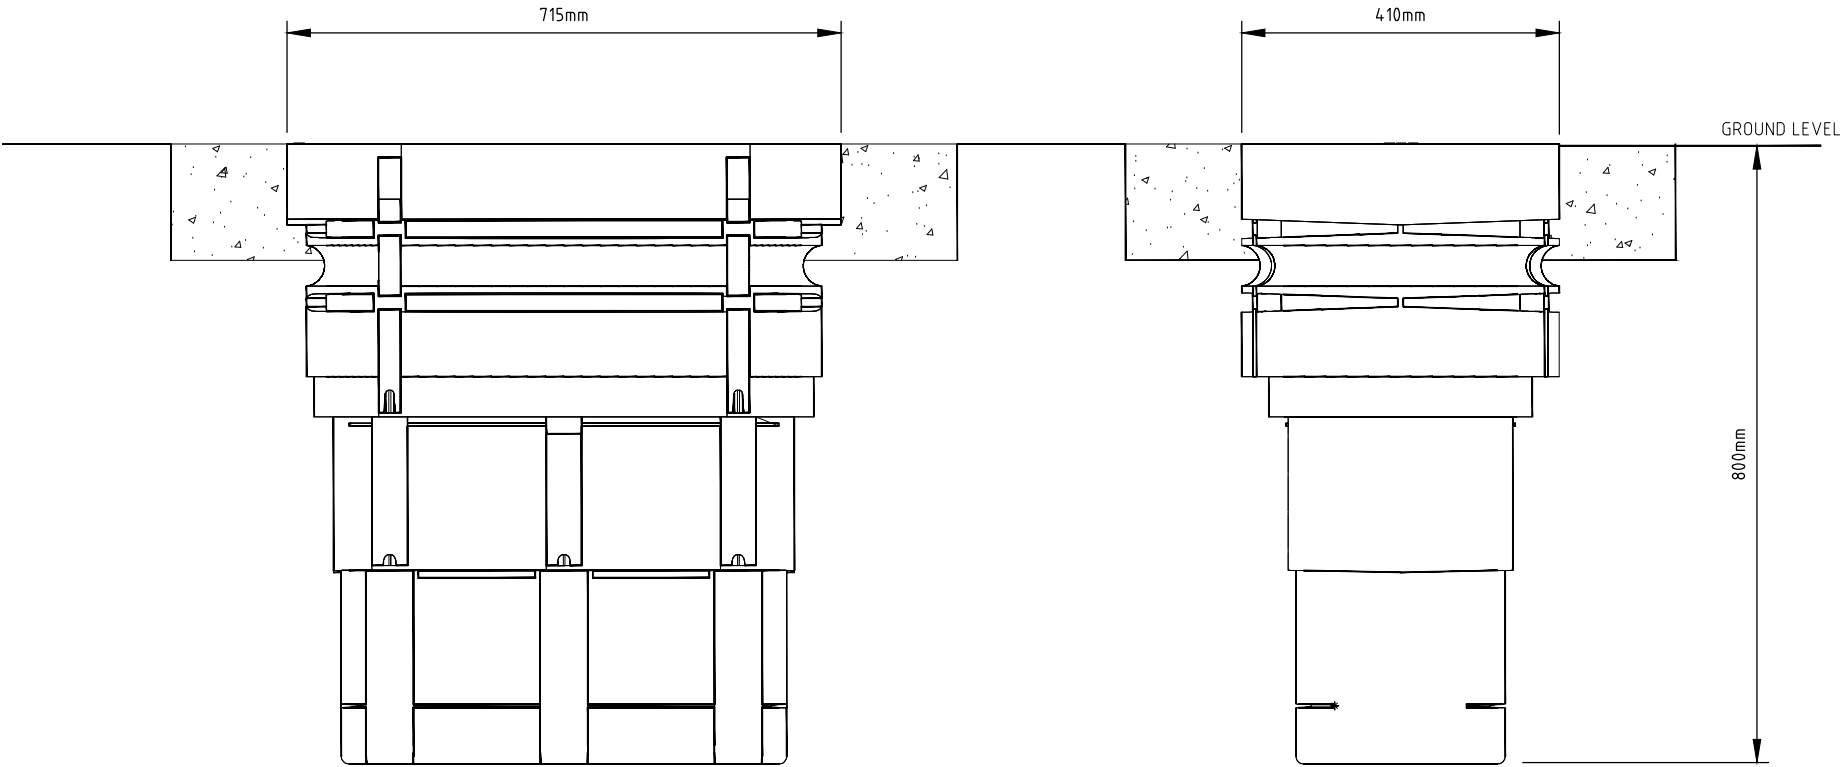


ELEVATION/SECTION

END ELEVATION/SECTION

NOTES:

1. ACO PIT TYPE 4 OR EQUAL.
2. CABLE JOINTING PIT MATERIAL TO BE HIGH DENSITY POLY-ETHYLENE.
3. CONCRETE COVER TO HAVE A MINIMUM COMPRESSIVE DESIGN STRENGTH OF N32/20/80.
4. ALL REINFORCEMENT, CONCRETE AND CONCRETE MATERIALS SHALL BE IN ACCORDANCE WITH AS1379 AND AS3600.
5. ENGRAVED LETTERING IN CONCRETE COVER TO BE "ELECTRICAL".
4. CONCRETE COVER TO HAVE A NON-SLIP FINISH ON THE UPPER SURFACE.
5. AREA AROUND LID MUST BE RIGIDLY SUPPORTED BY MIN 150mm WIDE x 150mm DEEP CONCRETE SURROUND AS SHOWN.

SCALE: N.T.S.

					DRAWN C J		CHECKED PB		<div></div> <div>SUBDIVISION DEVELOPMENT GUIDELINES STANDARD DRAWINGS LIGHTING</div> <div>CABLE PIT TYPICAL DETAILS</div>								
					DATE AUGUST 2020		DATE AUGUST 2020										
					DESIGNED C J		CHECKED PB										
					DATE AUGUST 2020		DATE AUGUST 2020										
					DESIGN PROJECT LEADER PB		NTG PROJECT MANAGER N/A										
					DATE AUGUST 2020		DATE AUGUST 2020										
										NTG PROJECT No.			NTG ASSET No.	SHEET No.	NTG DRAWING No.	AMENDMENT	SHEET SIZE
										-			-	12 OF 16	SS5011	0	A1

0

ISSUED AS A STANDARD DRAWING

AUG 2020

CJ

AF

No.	DESCRIPTION	DATE	INIT.	DEPT/COMPANY.
AMENDMENTS				